


**INSTALLATION INSTRUCTIONS**  
**& CONDITIONS FOR SAFE USE**



**Modular TERMINAL Blocks: AKZ- Series**

**TÜV 18 ATEX 8221 U**  
**IECEX TUR 18.0024 U**  
**Notified Body No. of Ex - QA: 0344**  
**Label print on package unit: 0344**

Standards:  
EN 60079-0:2012 + A11 2013 and EN 60079-7:2015  
IEC 60079-0: 6th Edition and IEC 60079-7: 5th Edition

**Modular Terminal Blocks: AKZ 1.5**

Version:	AKZ 1.5*	Order No 0340460000
in conjunction with:	AKE 2.5	1303360000
Accessories:	Type	
end plate	AP AKZ1.5*	0340560000
end bracket	EW 15*	0382860000
	EW 15/2*	1071900000
Terminal rail	TS 15/... acc.to IEC 60715	
Cross-connection	Q 2 AKZ1.5	0368200000
	Q 3 AKZ1.5	0368300000
	Q 4 AKZ1.5	0368400000
	Q 10 AKZ1.5	0368500000

**Insulation material:**

- Type PA
- Tracking resistance (A) to IEC 60112 CTI ≥ 600
- Flammability class to UL 94 V2
- Operating temperature range -50 °C to +85 °C (insulating material limit)
- Ambient temperature range -50 °C...+40 °C (for T6 applications)
- Ambient temperature range -50 °C...+45 °C (for T5 applications)
- Ambient temperature range -50 °C...+45 °C (for T4 applications)

\* in all colours

**Technical data according to IEC/EN 60079-7 (increased safety "eb"):**


	<b>AKZ 1.5</b>	<b>AKE 2.5</b>
- Rated voltage	220 V	
- Rated current	17,5 A	
- Temperature rise with rated current	≤ 40 K / 17,5 A	
- Rated current with cross connection	17,5 A	
- Contact resistance with rated conductor	0,46 mΩ	0,30 mΩ
- Conductor cross section solid	0,5 - 2,5 mm <sup>2</sup>	0,5 - 4 mm <sup>2</sup>
- Conductor cross section stranded	1,5 mm <sup>2</sup>	0,5 - 2,5 mm <sup>2</sup>
- Conductor cross section flexible	0,5 - 1,5 mm <sup>2</sup>	0,5 - 2,5 mm <sup>2</sup>
- cross section, American Wire Gauge	24 - 14 AWG	26 - 12 AWG
- Tightening torque range, terminal screw	0,4 - 0,6 Nm	0,4 - 0,6 Nm
- Tightening torque range, fixing screw		0,4 - 0,8 Nm
- Tightening torque range for cross connection	0,4 - 0,8 Nm	
- Stripping length	7 mm	7 mm

**IECEx / ATEX Terminal and Cross-Connection Arrangements:**

**Max voltage data according to IEC/EN 60079-7 in conjunction with protective earth terminal blocks of the AKZ-Series, (increased safety "eb"):**


**Application Case**

**A - Continuous**




220 V

**C - Adjacent – separated by an end plate**

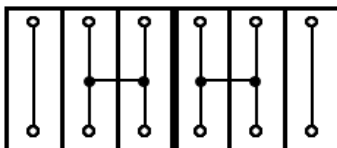


137 V

**D - Intermediate - bridging one or more unconnected terminals**



110 V

**E - Next to a protective conductor terminal (earth)**



220 V

Information for further cross-connector arrangements will be provided on request.

**Note:**

If smaller cross sections than the rated cross section are used, the belonging lower current has to be laid down in the IECEx/EC-Type Examination Certificate of the complete apparatus.

**Mounting instructions:**

Regarding the use of accessories the instructions of the manufacturer must be followed.

**Schedule of Limitations:**

The AKZ/AKE-series products are suitable for use in enclosures in atmospheres with flammable gases or combustible dust. For flammable gases these enclosures must satisfy the requirements according to EN 60079-0 and EN 60079-7. For combustible dust the enclosure must satisfy the requirements according to EN 60079-0 and EN 60079-31.

The enclosure shall be constructed to block all sun and UV light from affecting the terminal blocks. The terminal blocks shall be placed inside a suitable certified IP54 enclosure in type of protection "eb" for gas atmosphere. For dust atmosphere the terminal blocks shall be mounted inside a suitable certified enclosure (EN60079-31) in type of protection "t".

Under normal operating conditions the temperature rise of the terminal blocks is maximum 40 K, measured at the maximum permitted rated current. Due to the above mentioned, the terminal blocks may be used in apparatus of temperature classes T6..T1 as long as the terminal block ambient temperature range is not exceeded. No part of terminal block must exceed 85 °C under any condition.

**Ambient temperature**

T6 (- 50°C ... +40 °C)

T5 (- 50°C ... +45 °C)

T4 (- 50°C ... +45 °C)

When using the AKZ/AKE-series products especially with other terminal blocks series or sizes or accessories the requirements for clearance and creepage distances according to table 1 of EN 60079-7 must be observed. Regarding the use of covers, cross-connectors and end brackets the instructions of the manufacturer must be followed.

For cross connection accessories current rating, resistance across the terminal please refer to the table under "technical data" above.

No other wire sizes or types than the ones specified in instructions must be used. The terminal blocks must either be mounted next to another block of the same type and size or with an end plate.

If smaller conductor cross sections than the rated conductor cross sections are used, then the corresponding lower current shall be stated in the Certificate of the complete apparatus.

Unused terminals shall be tightened.

**Essential Health and Safety Requirements:**

Concerning ESRs this Schedule verifies compliance with the Annex III of ATEX directive only. By placing the product on the market, the manufacturer declares compliance with other relevant Directives, and all other safety related requirements including those of Annex II of this Directive.